

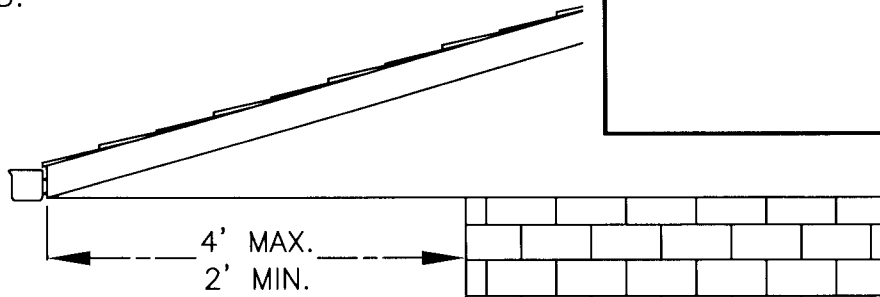


NOTE: IF CONDUIT IS FILLED WITH ICE AND WATER AN ADDITIONAL CHARGE WILL BE ADDED.

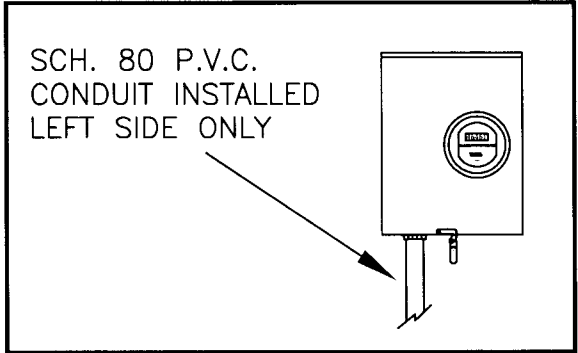

NOTE: TRENCH AND CONDUIT INSTALLATION MUST BE INSPECTED BY Y.V.E.A. BEFORE BACKFILL.

1. METER SOCKET PROVIDED BY Y.V.E.A.
2. METER LOCATIONS MUST BE APPROVED BY Y.V.E.A. BEFORE METER SOCKET WILL BE ISSUED OR SERVICE CONNECTED. METER LOCATIONS SHALL BE SUCH THAT THE METER IS EASILY ACCESSIBLE FOR READING, TESTING AND SERVICING.

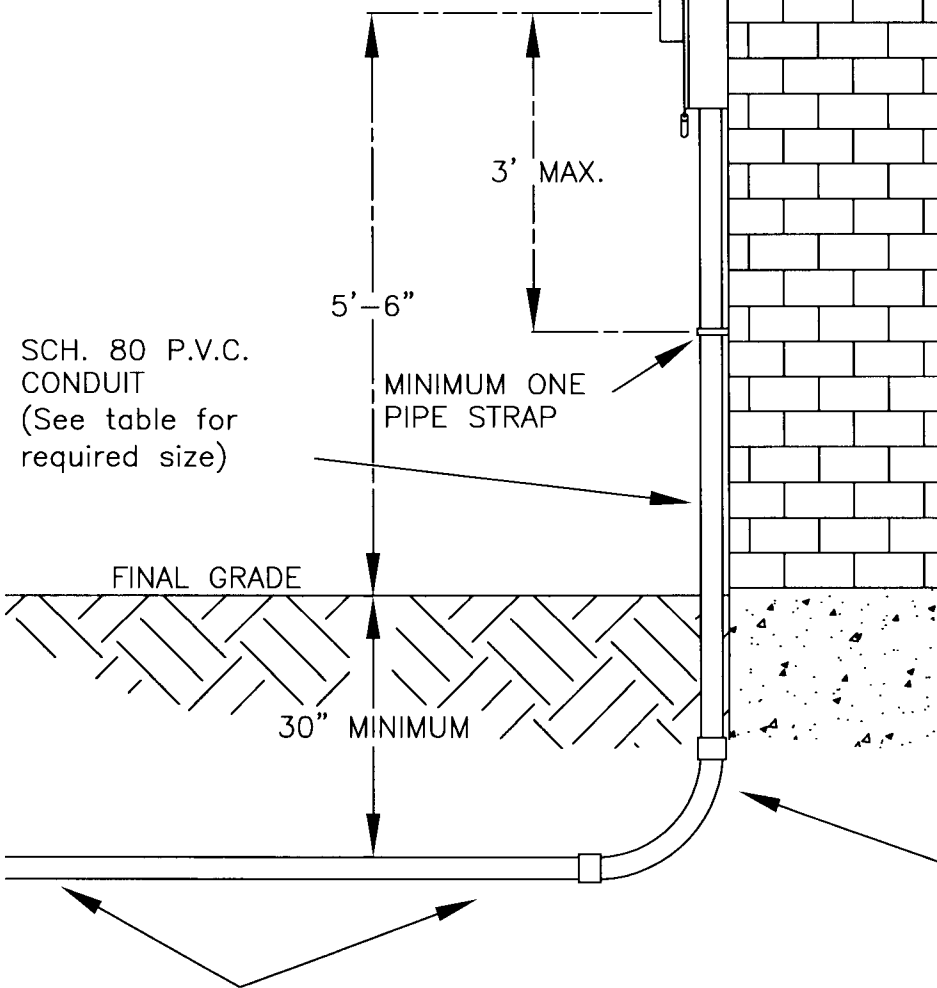

SCH. 80 P.V.C. CONDUIT  
(See table for required size)

SCH. 40 P.V.C. SWEEP.  
NO MORE THAN A TOTAL OF 270° BENDS IN COMPLETE RUN. (24" RADIUS)

MAXIMUM LENGTH 100' FROM SERVICE TO SECONDARY PEDESTAL OR TRANSFORMER. THIS CONDUIT SHALL HAVE PULL ROPE (MINIMUM 1/4") INSTALLED.

SERVICE CABLE SIZE SELECTED BY YVEA	CONDUIT SIZE
#4/0 or #1/0	3"
#4/0 OR 350 kcmil	3"