


YVEA SYSTEM

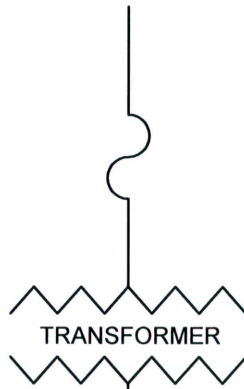

YVEA FACILITIES

MEMBER/CONSUMER FACILITIES

NOTES:

1. INSTALLATION SHALL CONFORM TO THE NATIONAL ELECTRICAL CODE, ARTICLES 701 OR 702 (Legally Required or Optional Standby Systems) AND ANY OTHER ARTICLES/SECTIONS THAT MAY APPLY.
2. INSTALLATION SHOULD BE PERFORMED BY A LICENSED ELECTRICIAN.
3. CITY, TOWN OR COUNTY INSPECTION REQUIRED PRIOR TO YVEA ACCEPTANCE.

SERVICE ENTRANCE DISCONNECT DEVICE
(VISIBLE, ACCESSIBLE AND LOCKABLE)
OPTIONAL, BUT RECOMMENDED

TRANSFER SWITCH
(DOUBLE POLE - DOUBLE THROW, BREAK-
BEFORE-MAKE AND MECHANICALLY INTERLOCKED)

DISTRIBUTION
PANEL

STANDBY SYSTEM
(GENERATOR)

K:\Drawings\Interconnect



YAMPA VALLEY ELECTRIC ASSOCIATION
STEAMBOAT SPRINGS AND CRAIG,
COLORADO
COLORADO ROUTT 36

DRAWN BY: TEC

PUBLISHED: January 19, 2011

SCALE: NTS

STANDBY SYSTEM (GENERATOR)